



# DOOR INT SEAL REQUIREMENTS

## FIRE RATING ONLY

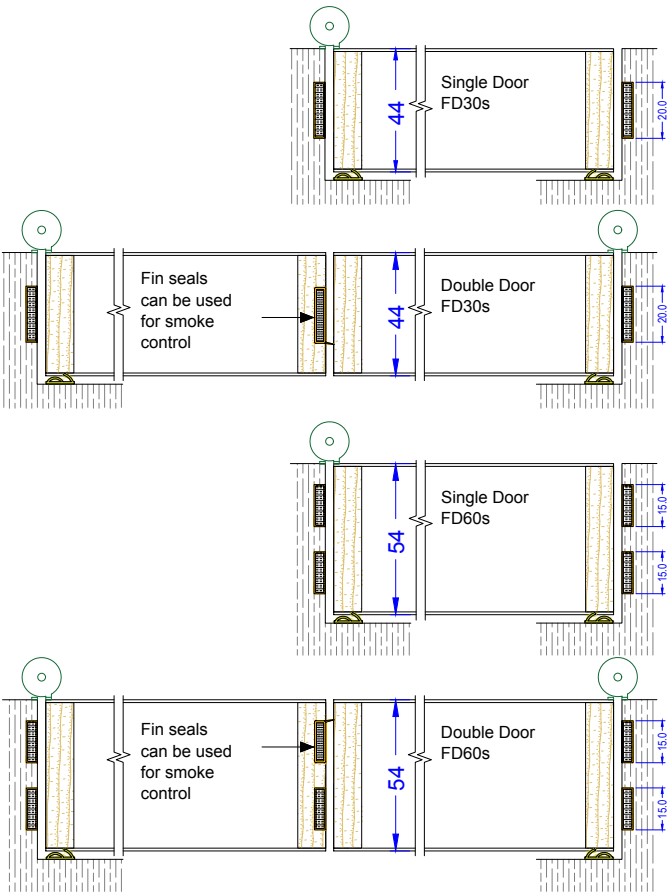

## FIRE RATING + dB Acoustic

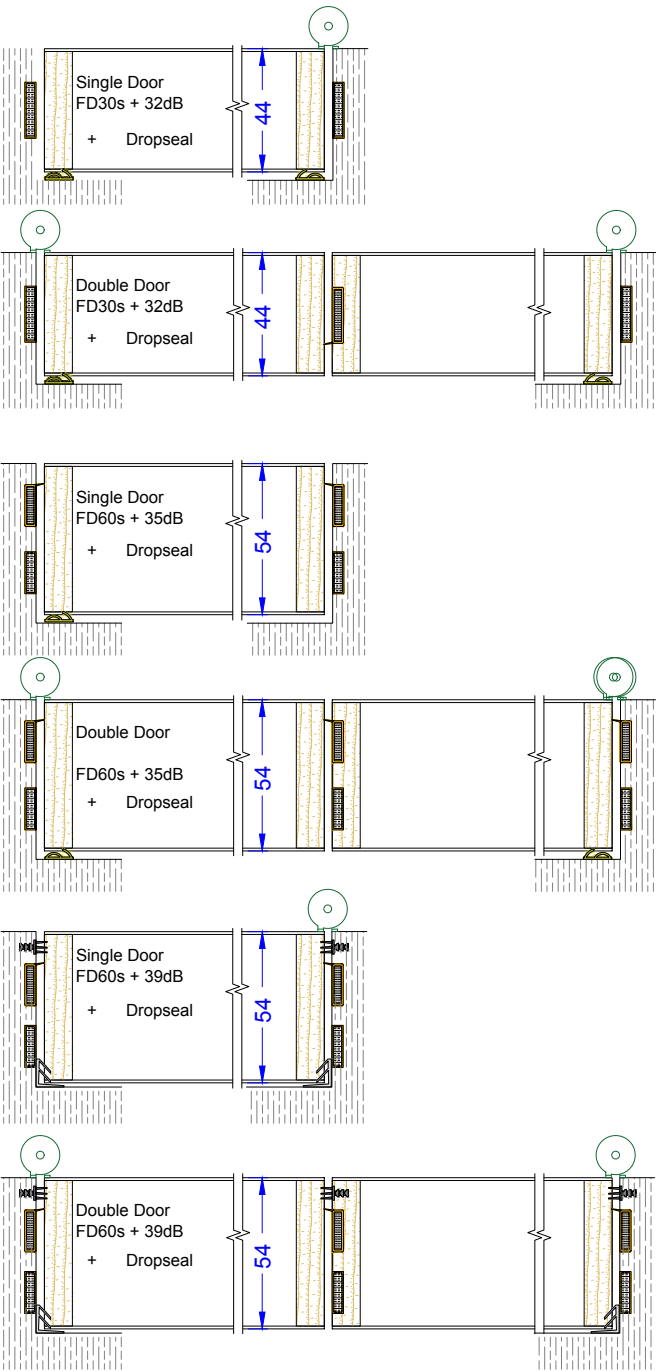

### Please note

Seals can be fitted to frames as shown or to the door leaves themselves.

If smoke control is required, there must be an ST1009 perimeter seal placed in the door stop reveal as an addition to the flat and fin seals.

If the threshold gap is greater than the maximum 3mm for smoke control, a drop seal must be fitted for threshold gaps up to 10mm.



forza-doors.com  
01403 711 126  
info@forza-doors.com

PROJECT: Intumescent seals  
PROJECT REF: General  
DRAWN BY: MR  
DRAWING NO: FZ 291118-51  
REVISION NO: 0  
DATE: 29/11/18

DESCRIPTION  
Initial layouts for approval