

FORZA REFERENCE


GFP7-30/0-34

Rating according to BS EN ISO 717-1:1997

Rw(C:Ctr)= 34(0;-3)dB

Test Number:	AC 4289		Air Temperature (°C):	19.5
Testcentre/Client	BBRI/Glaverbel S.A		Air Humidity (%):	45
Test Date:	22/01/2007		Receiving room Volume (m³):	49.2m3
Sample height (m):	1.48m		Source Room volume (m3):	50.5m3
Sample width (m):	1.23m		Sample weight (kgs):	27.3
Product:	Pyrobelite 7			

Frequency f Hz	Sound Reduction Index, dB	
	1/3 Oct	1/1 Oct
50		22.2
63		
80		
100	22.0	
125	21.1	26.8
160	23.8	
200	25.9	
250	26.3	
315	28.5	32.1
400	30.5	
500	32.5	
630	33.8	
800	34.3	34.8
1000	35.2	
1250	34.8	
1600	34.0	
2000	33.7	34.8
2500	37.5	
3150	42.0	
4000	45.9	
5000	49.4	44.8
6300+		
8000+		
10000+		
Average 100-3150		

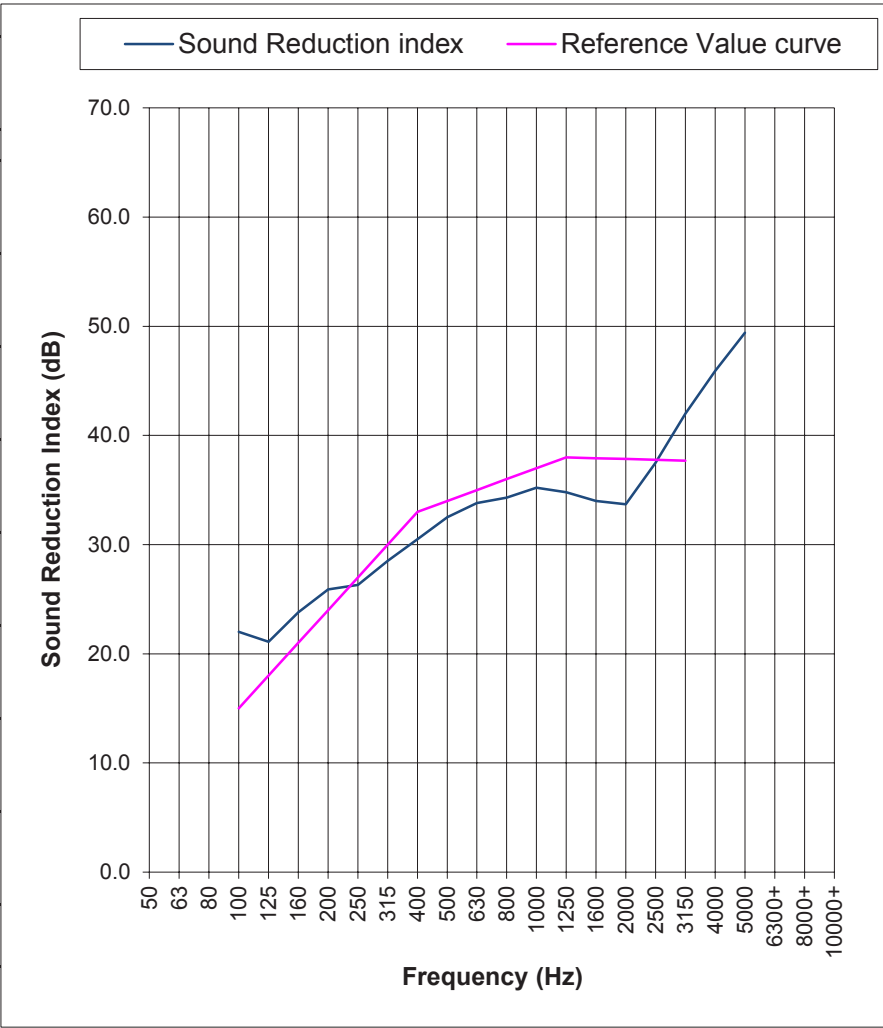

Notes	5mm acoustic putty between timber liner and glass edge



forza-doors.com
01403 711 126
tech@forza-doors.com