


**FORZA REFERENCE**  
**ASG44.34A30GS**



Rating according to BS EN ISO 717-1:2013

**Rw(C:Ctr)= 34 (-1:-2) dB**

|                     |                                                                |                             |      |
|---------------------|----------------------------------------------------------------|-----------------------------|------|
| Test Number:        | 23                                                             | Air Temperature (°C):       | 13.5 |
| Testcentre/Client:  | FORZA                                                          | Air Humidity (%):           | 51   |
| Test Date:          | 25/02/2016                                                     | Receiving room Volume (m³): | 300  |
| Area test sample m2 | 2.31                                                           | Source Room volume (m3):    | 115  |
|                     |                                                                | Sample weight (kg/m²):      |      |
| Product:            | 44mm timber particleboard core in a generic aluminium frame ** |                             |      |
| Identification:     | Seals: Head and jambs - ST1009 / 1no. 20 x 4                   |                             |      |
|                     | Threshold ST422                                                |                             |      |
|                     | Glazing GFP12.4 Fire Glass                                     |                             |      |

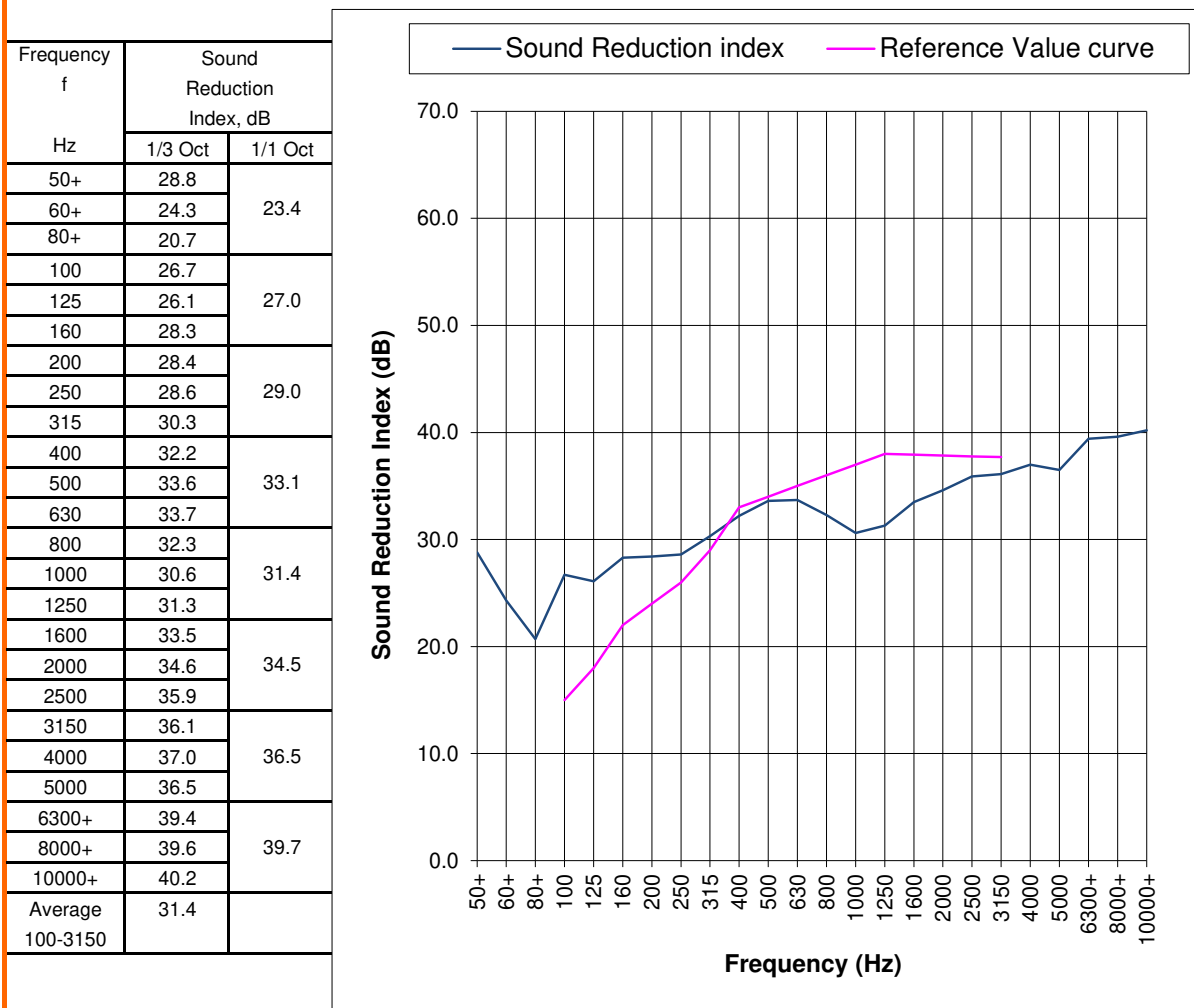

|       |                                                                  |
|-------|------------------------------------------------------------------|
| Notes | + designates frequency beyond standard and not UKAS accredited   |
|       | *designated measurement corrected for background                 |
|       | ** As frame is generic - please regard this data as a guide only |