


FORZA REFERENCE

GP12.8A40

Rating according to BS EN ISO 717-1:1997

Rw(C:Ctr)= 40(-1;-3)dB

Test Number:	AC3752		Air Temperature (°C):	20
Testcentre/Client:	BBRI/Glaverbel S.A		Air Humidity (%):	40
Test Date:	02/06/2004		Receiving room Volume (m³):	49.2
Sample height (m):	1.48		Source Room volume (m3):	50.5
Sample width (m):	1.23		Sample weight (kgs):	56.4
Product:	12.8 AGC Stratophone (66.2)			

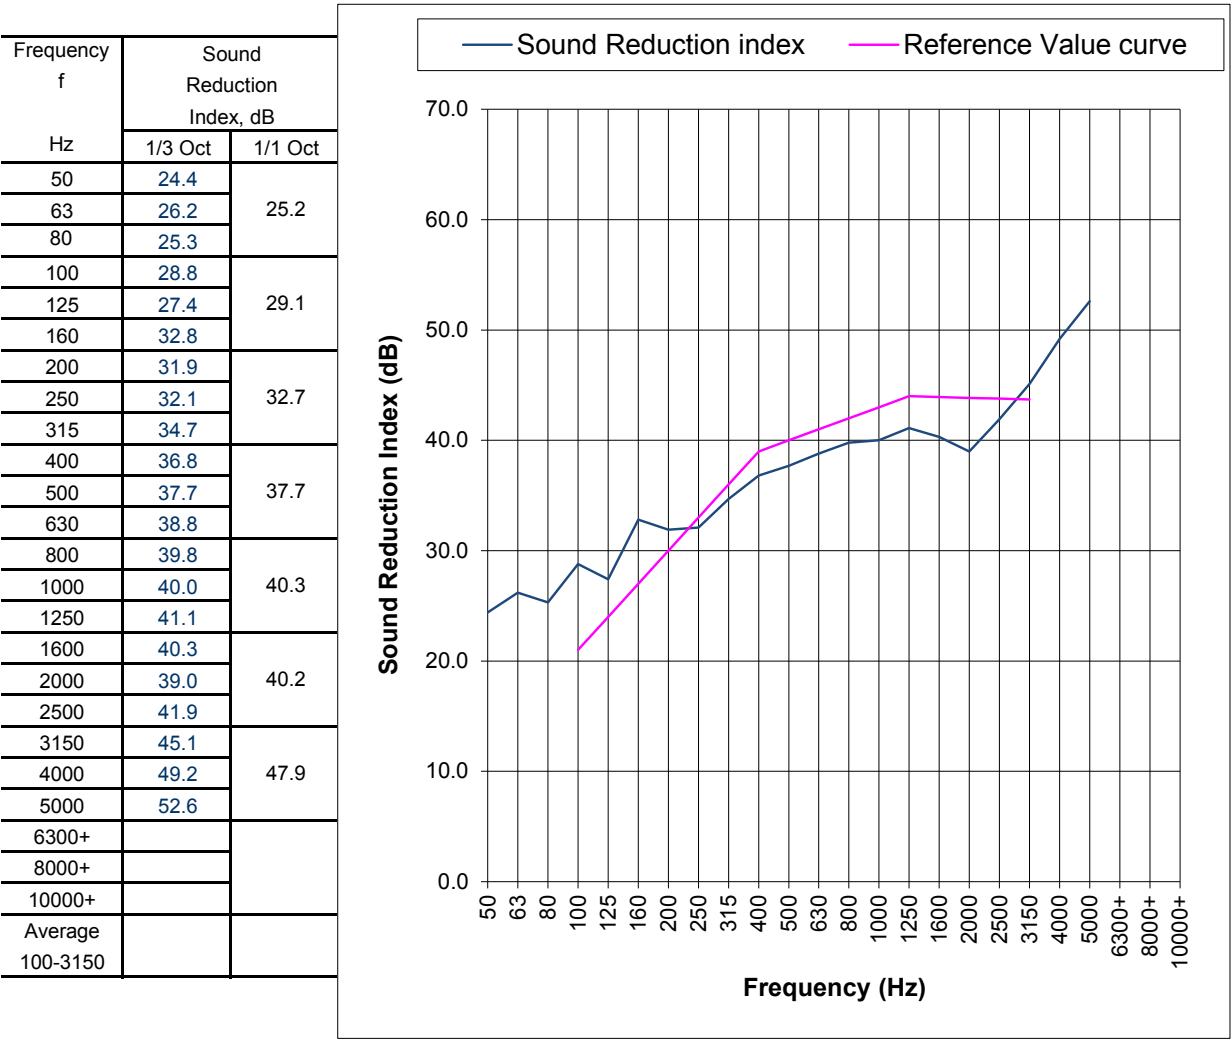

Notes	5mm acoustic putty between timber liner and glass edge



forza-doors.com
01403 711 126
tech@forza-doors.com