

FORZA REFERENCE


GFP12-60/0-36

Rating according to BS EN ISO 717-1:1997

Rw(C:Ctr)= 36(-1;-3dB)

Test Number:	AC4292	Air Temperature (°C):	21
Testcentre/Client:	BBRI/Glaverbel S.A	Air Humidity (%):	46
Test Date:	19/01/2007	Receiving room Volume (m³):	49.2
Sample height (m):	1.48	Source Room volume (m³):	50.5
Sample width (m):	1.23	Sample weight (kgs):	40.95
Product:	Pyrobelite 12		

Frequency f Hz	Sound Reduction Index, dB	
	1/3 Oct	1/1 Oct
50		25.8
63		
80		
100	25.0	
125	24.7	30.8
160	28.8	
200	29.2	
250	31.3	
315	32.5	34.9
400	34.4	
500	35.3	
630	35.2	
800	33.0	32.8
1000	32.2	
1250	33.3	
1600	36.3	
2000	39.7	39.0
2500	44.2	
3150	48.6	
4000	52.0	
5000	54.8	51.1
6300+		
8000+		
10000+		
Average 100-3150		

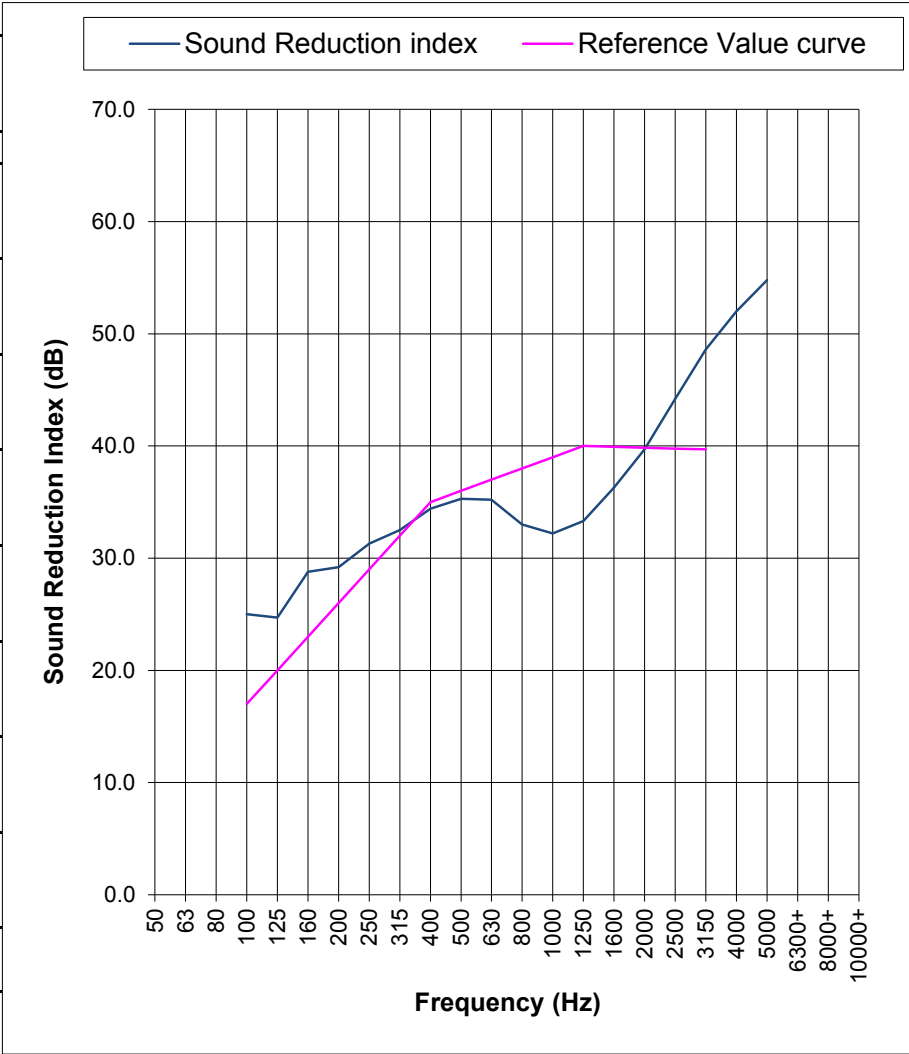

Notes	5mm acoustic putty between timber liner and glass edge



forza-doors.com
01403 711 126
tech@forza-doors.com